

NOTES

1. ALL DIMENSIONS ARE IN MM & L/4 IN DRG.
2. READ IN CONNECTION WITH RELEVANT ARCH. DRG.
3. FINISHED FLOOR LVL. TO BE CONFERRED
AS/ARCH. DRGS. THE SLAB TOP LEVEL TO
BE WORKED OUT SUITABLY CONSIDERING
FLOOR FINISH THICKNESS.
4. CLEAR COVER OF R/F TO BE AS BELOW:-

FOUNDATION	= 50mm
COLUMN	= 40mm
BEAM	= 30mm
SLAB	= 25mm
5. CONC. MIX. TO BE M-25 FOR ALL RCC WORK
AS PER IS:4620-2000
6. ALL R/F BARS TO BE #400 Mpa. HYSD
OR NAT STEEL AS PER IS:1786.
7. ALL LVL LENGTHS = 50xSMALLER BAR Ø.
ALL LVS TO PLANNED SUITABLY AS PER
SITE REQUIREMENT.
8. DEVELOPMENT LENGTH = 50xBAR Ø.


0	14.03.13	FOR TENDER
REV	DATE	DESCRIPTION

REVISION


PROJECT

PROPOSED
100 BEDDED HOSPITAL
AT JAUNPUR


TITLE

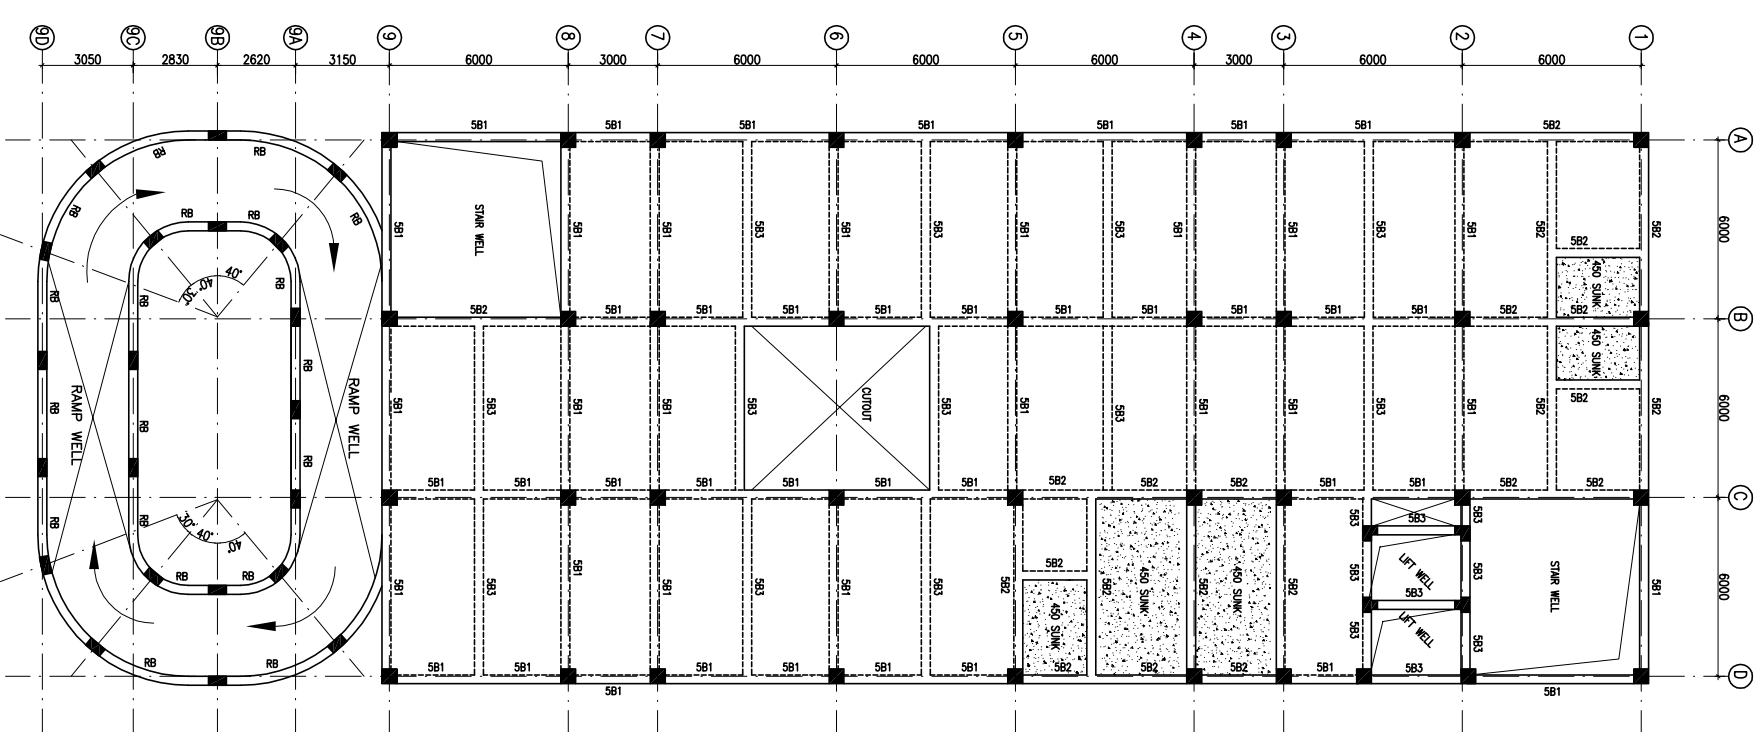


FIFTH FLOOR BEAM FRAMING PLAN
(SLAB THICKNESS 125mm U.N.O.)

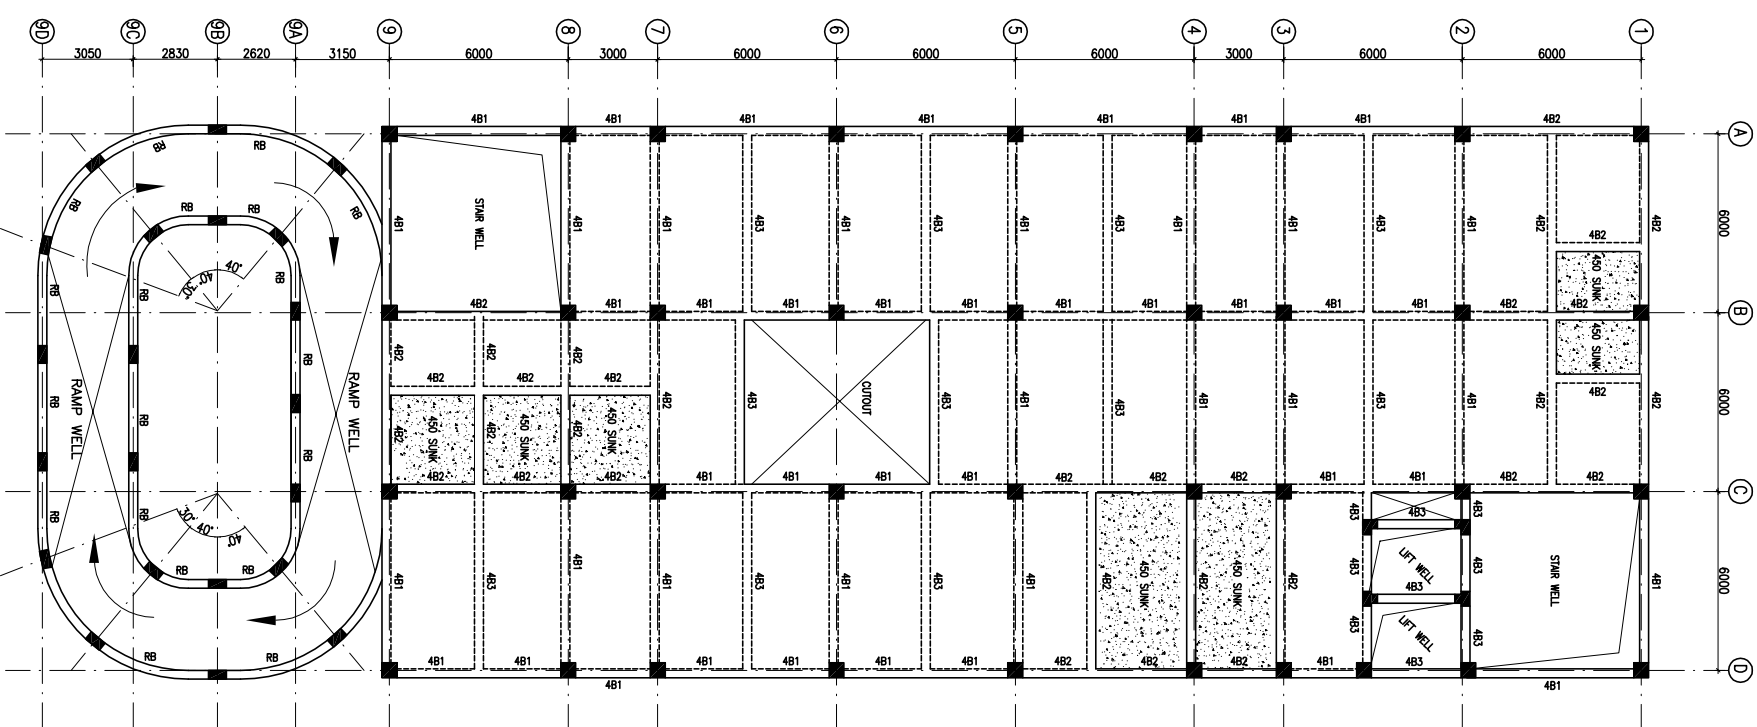


FOURTH FLOOR BEAM FRAMING PLAN
(SLAB THICKNESS 125mm U.N.O.)

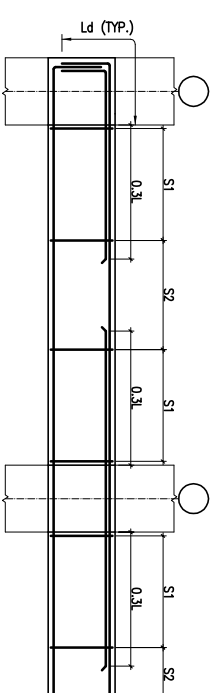

TYP. BEAM R/F DETAILS



TYP. SUNKEN SLAB R/F DETAIL



TYP. SLAB R/F DETAIL

BEAM SCHEDULE:—

BEAM MKD.	SIZE
4B1	300x500
4B2	300x575
4B3	300x450

BEAM SCHEDULE:-

BEAM MKD.	SIZE
5B1	300x500
5B2	300x575
5B3	300x450